

JAYPRO INFRATECH PVT.LTD.


Our Services
 Architecture Design
 Structure Design
 Interior Design
 Estimating & Costing
 Building Construction With Material

Outer Wall- 10"
 Inner Wall- 05"

SCHEDULE OF DOOR & WINDOWS			
SP.	L	B	H
			SILL H.
MD	4'0"	07'00"	00'00"
D	3'6"	07'00"	00'00"
D1	3'0"	07'00"	00'00"
D2	2'6"	07'00"	00'00"
W1	4'0"	04'00"	03'00"
W2	3'0"	04'00"	03'00"
V	2'0"	01'06"	08'06"

Details Of Stair:-

Ceiling Height :- 10'
 Height Of Stair:- 5'
 Height Of Riser:- 5'
 Width Of Trade :- 10"
 Width Of Stair :- 3'-6"
 Width Of Landing :- 3'-6"
 Steps Of Stair :- 22




THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF
 PURPOSE AS STATED IN THE AGREEMENT AND IT SHALL NOT BE REPRODUCED,
 COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED
 FOR ANY OTHER PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.
 ALL DIMENSIONS ARE IN MILLIMETER UNLESS OTHERWISE SPECIFIED.

CLIENT :- MD FARUQUE SIR

PROJECT :- GROUND FLOOR PLAN

SCALE:-	1:100	ISSUED 04.11.25
Plan Number:-	03	
Design By	Ar.Soni kumari	
Checked By	Er. Jayprakash Kumar	
Approved By	Jaypro Infratech Pvt.Ltd.	

JAYPRO INFRATECH PVT. LTD.
 Office Address: 1st Floor, Pandooi
 Place, Boring Road, Patna- 800001



JAYPRO INFRATECH PVT.LTD.


Our Services
Architecture Design
Structure Design
Interior Design
Estimating & Costing
Building Construction With Material

Outer Wall- 10"
Inner Wall- 05"

SCHEDULE OF DOOR & WINDOWS					
SP.	L	B	H	SILL	H.
MD	4'0"		07'00"	00'00"	
D	3'6"		07'00"	00'00"	
D1	3'0"		07'00"	00'00"	
D2	2'6"		07'00"	00'00"	
W1	4'0"		04'00"	03'00"	
W2	3'0"		04'00"	03'00"	
V	2'0"		01'06"	08'06"	

Details Of Stair:-

Ceiling Height :- 10'
Height Of Stair:- 5'
Height Of Riser:- 5"
Width Of Trade :- 10"
Width Of Stair :- 3'-6"
Width Of Landing :- 3'-6"
Steps Of Stair :- 22




THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF
PURPOSE AS STATED IN THE AGREEMENT AND IT SHALL NOT BE REPRODUCED,
COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED
FOR ANY OTHER PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.
ALL DIMENSIONS ARE IN MILLIMETER UNLESS OTHERWISE SPECIFIED.

CLIENT :- MD FARUQUE SIR

PROJECT :- FIRST FLOOR PLAN

SCALE:-	1:100	ISSUED 12.11.25
Plan Number:-	03	
Design By	Ar.Soni kumari	
Checked By	Er. Jayprakash Kumar	
Approved By	Jaypro Infratech Pvt.Ltd.	

JAYPRO INFRATECH PVT. LTD.
Office Address: 1st Floor, Pandooi
Place, Boring Road, Patna- 800001

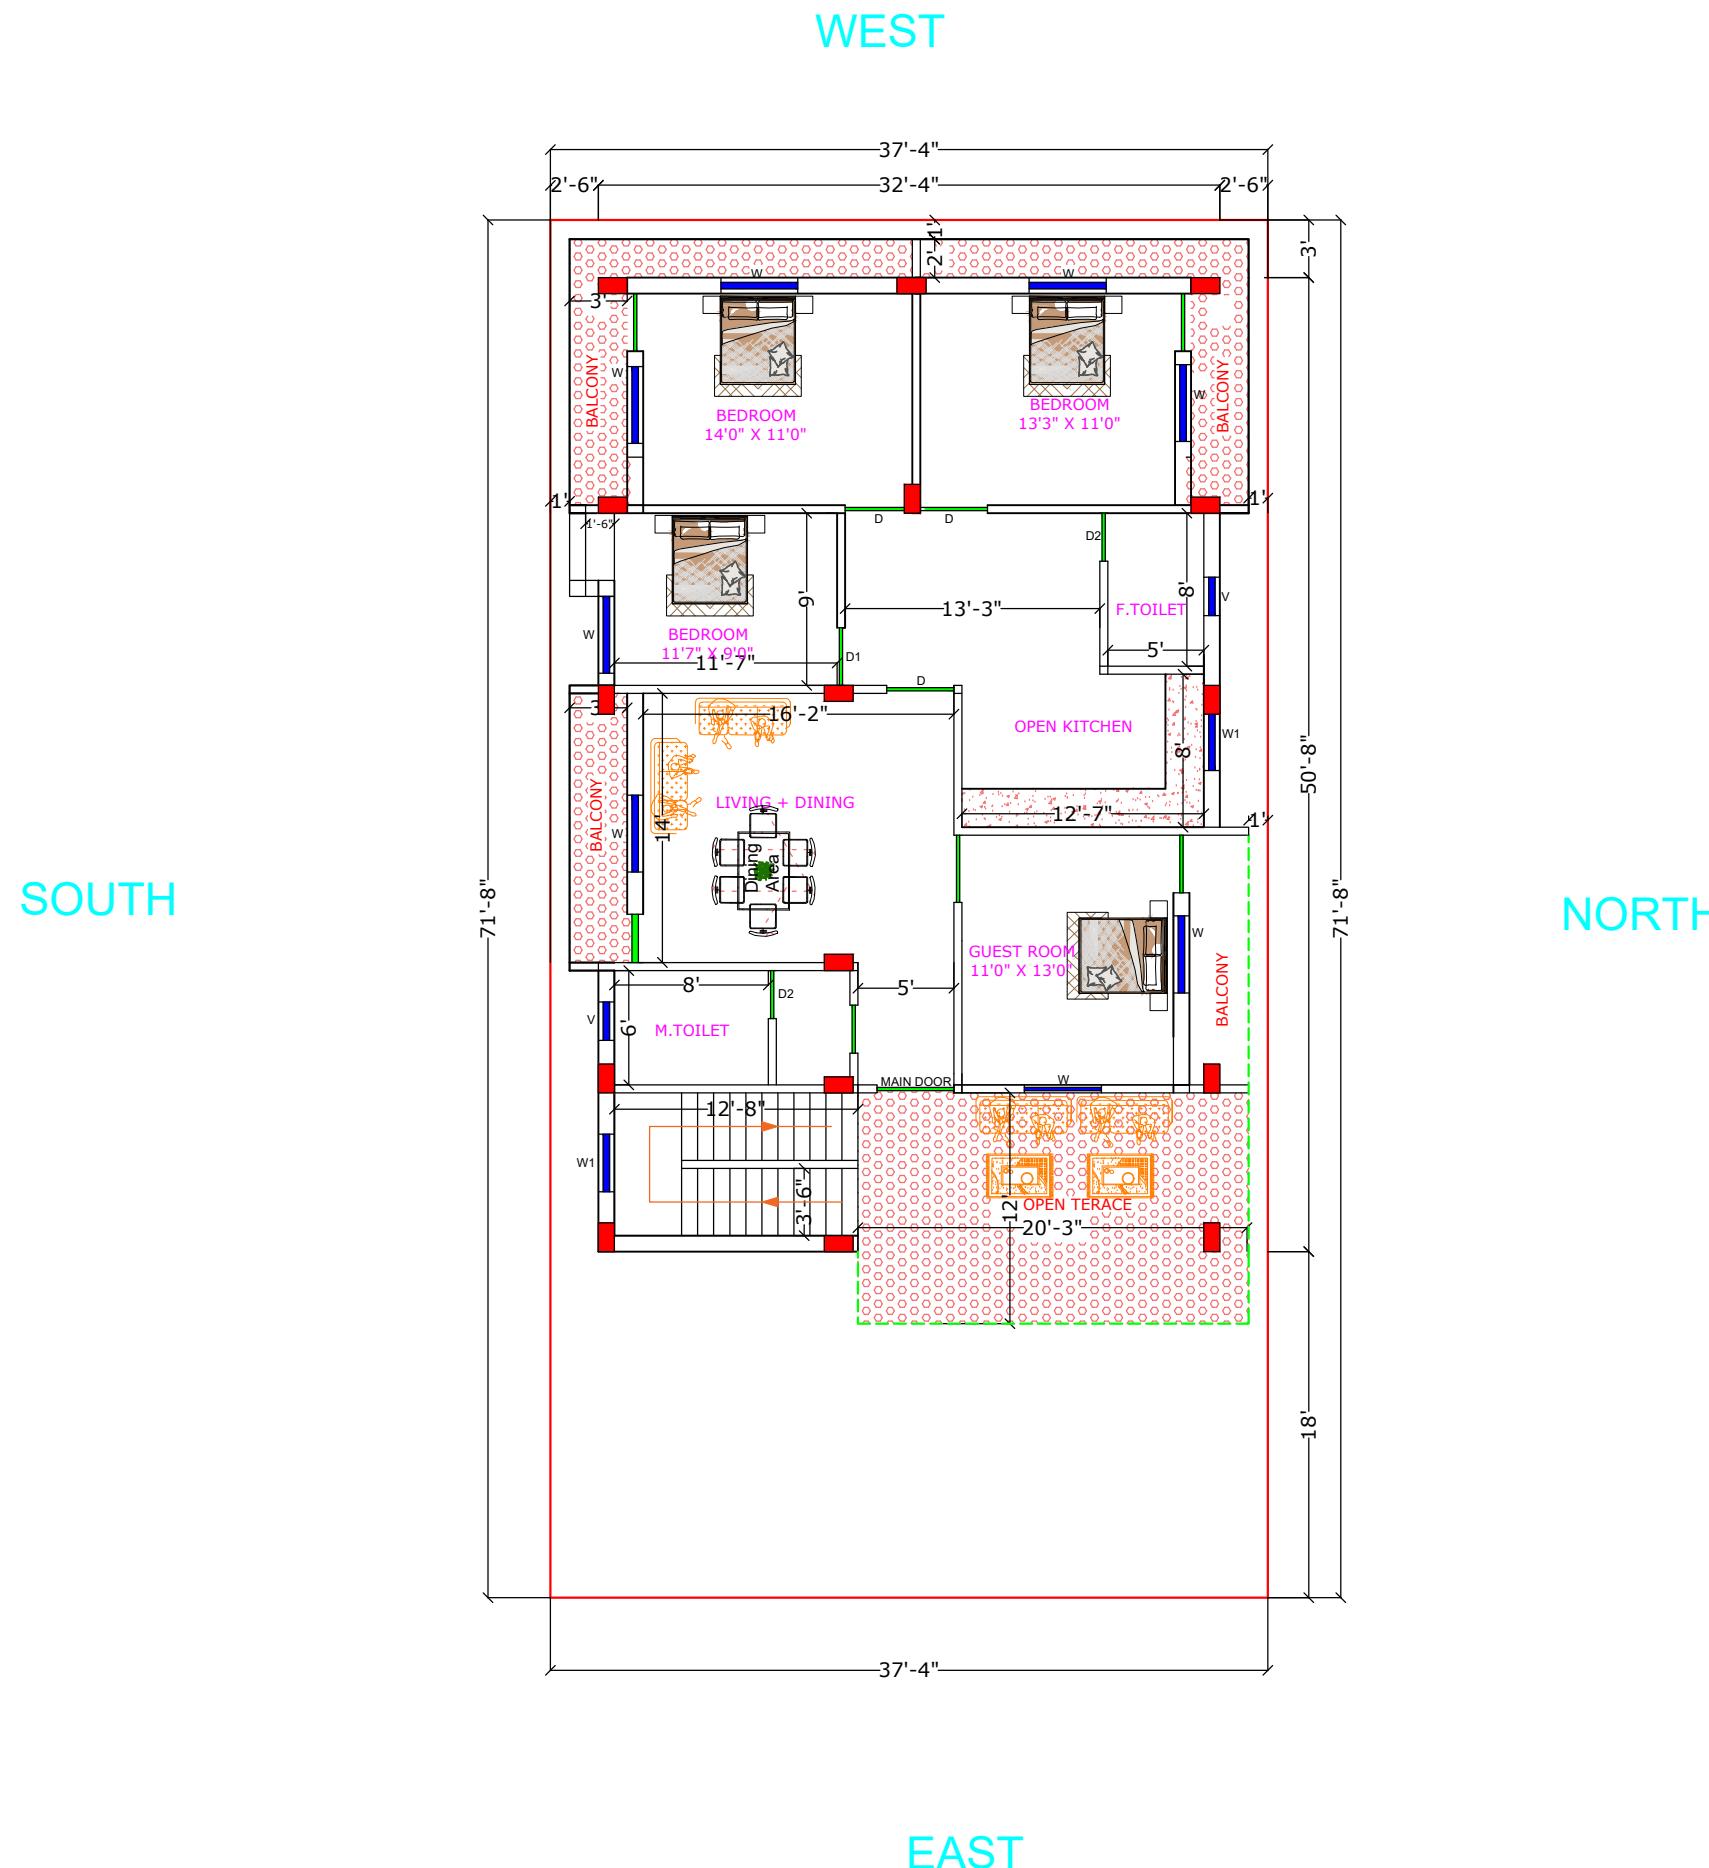

JAYPRO INFRATECH PVT.LTD.



- Our Services
- Architecture Design
- Structure Design
- Interior Design
- Estimating & Costing
- Building Construction With Material

SOUTH

WEST

NORTH

EAST

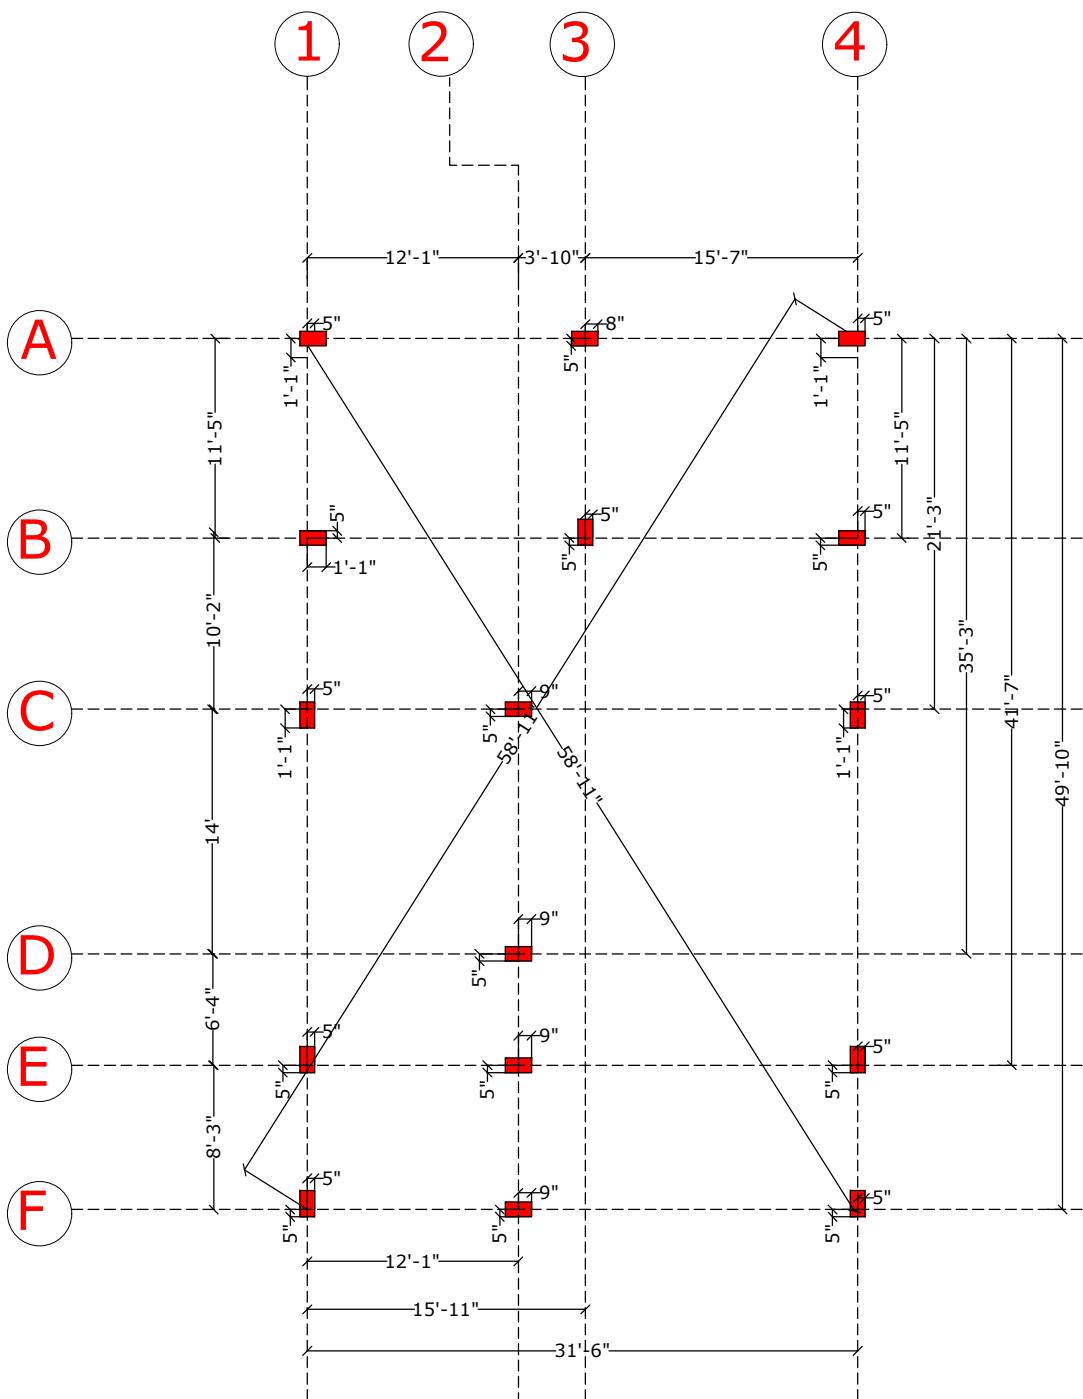

THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF
I.E.D., LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED
FOR ANY OTHER PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.
ALL DIMENSIONS ARE IN MILLIMETER UNLESS OTHERWISE SPECIFIED.

CLIENT :-

PROJECT :- Column Layout Details

SCALE:-	1:100	ISSUED	12.04.25
Plan Number:-	01		
Design By	Er.Rishav Kumar		
Checked By	Er. Jayprakash Kumar		
Approved By	Jaypro Infratech Pvt.Ltd.		

JAYPRO INFRATECH PVT. LTD.
Office Address: 1st Floor, Pandooi

TECHNICAL NOTES & INSTRUCTIONS:-

- NOTES AND INSTRUCTIONS INDICATED BELOW SHALL BE FOLLOWED WITH DUE RESPONSIBILITY BY ENGINEER IN CHARGE DURING EXECUTION OF THE PROJECT.
- THE ENGINEER IN-CHARGE SHALL STUDY THE PILE THE ARCHITECTURAL, STRUCTURAL, DESIGN AND CONSTRUCTION DRAWINGS AND REPORT TO CONSULTANT FOR ANY INQUIRY IF ANY NOTICED BY HIM SHALL BE REPORTED TO CONSULTANT, FOR NECESSARY ACTION.
- ALL DIMENSIONS AND LEVELS MENTIONED IN THE DRAWINGS ARE IN MILLIMETERS (MM).
- COVER BLOCK SHALL BE PROVIDED AS PER DESIGN AS PER R.C.C. CODE.
- COVER BLOCK SHALL BE PROVIDED AS PER DESIGN AS PER R.C.C. CODE.
- THE CRUSHING STRENGTH OF CUBES PREPARED WITH CEMENT / MIX AT WORK SITE SHALL BE NOT LESS THAN 40 N/mm².
- COVER BLOCK WITH PROPER SIZE & SPECIFIED STRENGTH SHALL BE PROVIDED IN SLAB / BEAM / COLUMN AS/DESIGN.
- COVER BLOCK SHALL BE PROVIDED AS PER DESIGN AS PER R.C.C. CODE.
- COVER BLOCK SHALL BE PROVIDED AS PER DESIGN AS PER R.C.C. CODE.
- IN CASE OF PILE FOUNDATION IT IS ESSENTIAL TO HAVE ACTUAL PILE LOAD TEST REPORT ALONG WITH PILE CAPACITY BASED ON SOIL PARAMETERS. SO IT IS INSTRUCTED TO GET THE ACTUAL PILE CAPACITY REPORT BEFORE EXECUTION AND REPORT TO CONSULTANT FOR REVIEW AND FINAL CONCLUSION.
- IN CASE OF PILE FOUNDATION HAVING HIGH WATER TABLE USE BENTONITE CASING AND CONCRETE CASING. THE ENGINEER IN-CHARGE SHALL TAKE FINAL DECISION AS PER ACTUAL SITE CONDITIONS.
- ALL CONCRETE SHALL BE MACHINED MIXED AND PROPERLY COMPACTED BY GRADERS.
- ALL CONCRETE SHALL BE CURED AS PER THE CONSULTANT'S RECOMMENDATION, INCLUDING LINKS FOR FOUNDATION - 50, PILE CAP - 75, COLUMN - 40, BEAM - 30 AND SLAB - 25mm THICKNESS.
- PROPER CURE OF R.C.C. SLAB / COLUMN / FOUNDATION / B/W PLASTER ETC. SHALL BE PROVIDED AS PER DESIGN.
- PROPER ARRANGEMENT FOR STACKING OF BRICKS SHALL BE ENSURED BY FIELD ENGR.
- BEFORE PLACING OF REINFORCEMENT POLYTHENE SHEET SHALL BE SPREAD OVER THE CONCRETE FLOOR.
- BEFORE CASTING REINFORCEMENT PLACED SHALL BE DULY MEASURED BY ENGR INCHAGE.
- L.D.T. (EFFECTIVE DEVELOP. LENGTH) CONSIDERING TENSION 40% BAR R.D.
- 100% OF THE LENGTH OF THE REINFORCEMENT SHALL BE TIED WITH 10% DIA.
- LAP SPLICING - NOT MORE THAN 50% OF AREA OF STEEL (LONG) IN COLUMN BARS SHALL BE SPliced AT ANY ONE SECTION. LENGTH OF SPlicing OF RT. SHALL BE STATED.
- IT SHALL NOT EXCEED 1.25 TIMES THE LENGTH OF THE BAR WHICH IS GREATER THAN THE SPAN (L-1.25L).
- THE FORM WORK FOR (SPAN & BEAMS & SLAB) SHALL BE SO ASSEMBLED AS TO PROVIDE CAMBER AS PER DESIGN.
- CAMBER FOR NORMAL BEAMS SHALL BE 1 IN 250 OF THE SPAN OR 5MM PER METER OF SPAN AT THE CENTRAL POINT.
- FOR SLAB, THE CAMBER FOR SLAB CANTER AT THE FREE END SHALL BE SPAN / 50 OF THE PROJECTED LENGTH.
- BEFORE R.C.C. CASTING OF BEAMS-SLAB FORM WORK SHALL BE CHECKED PROPERLY TO AVOID ANY DEFECTS.
- REMOVAL OF FORM WORK SHALL BE AS PER STRIPPING TIME PRESCRIBED VIDE CL. 11.3 OF I.S. 456-2000 AND AS PER THE DESIGN.
- IN FRAME STRUCTURE ALL EXTERNAL STAIR WALL SHALL BE 10 THICK AND INTERNAL WALL SHALL BE 6 THICK, EXCEPT MENTIONED.
- NECESSARY PROTECTION MEASURES SHALL BE MADE FOR PLANT PROTECTION OF BUILDING AT LEVEL DECIDED BY E.E. TO AVOID WATER LOGGING AROUND BUILDING. THE WIDTH SHALL BE DECIDED BY E.E.
- WATER PROOFING COMPOUND SHALL BE USED IN CASTING OF SUNKEN SLAB ATERACE FLOOR SLAB TO PREVENT SEEPAGE.
- ALL LIQUID AGGREGATE GRADE M 25 HAVING MINIMUM CEMENT CONTENT 300 kg/m³. MAX. W.C. = 0.5 FOR COARSE AGGREGATE 20 mm SIZE CASTING SHOULD BE DONE AS PER MIX DESIGN.

T INDICATES HYS BARS OF GRADE Fe 500
THIS DRAWING SHALL BE READ WITH THE APPROVED ARCHITECTURAL DRAWINGS.

NOTES:-

- ALL CONCRETE MIX M:25 UNLESS OTHERWISE SPECIFIED.
- ALL T/R STEEL YIELD STRENGTH 500 N/mm².
- CLEAR COVER TO MAIN STEEL 50 MM IN COLUMN.
- DEPTH OF PILES SHALL BE MEASURED FROM CUT OFF LV / EXISTING G.L. WHICH EVER IS LOWER.
- CUT OFF LV FOR PILES SHALL BE AT BOTTOM OF PILE CAP ITSELF.
- PILE SHALL BE CASTED 300 MM ABOVE CUT OFF LV. THEN IT SHALL BE CHIPPED OFF UPTO CUT OFF LV.
- 500 MM LENGTH OF MAIN BAR FROM PILE EXTEND BEYOND CUT OFF LV. TO BE EMBEDDED INTO PILE CAPS.
- CENTRE OF PILE GROUP SHALL MATCH WITH CENTER OF COLUMN.

THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF
PURPOSE AS STATED IN THE AGREEMENT AND IT SHALL NOT BE REPRODUCED,
COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED
FOR ANY OTHER PURPOSE THAN THAT FOR WHICH IT WAS PROVIDED.
ALL DIMENSIONS ARE IN MILLIMETER UNLESS OTHERWISE SPECIFIED.


CLIENT :- MD FARUQUE SIR

Design :- PILE & PILE CAP DETAILS


SCALE	1:100	Issue	19.11.2025
Plan Number	01		
Design By	Ar. Soni Kumar		
Checked By	Er. Jayprakash Kumar		
Approved By	Jaypro Infratech Pvt. Ltd.		

W
S
N
E

JAYPRO INFRATECH PVT. LTD.
Office Address: 1st Floor, Pandoo Place, Boring Road, Patna- 80001

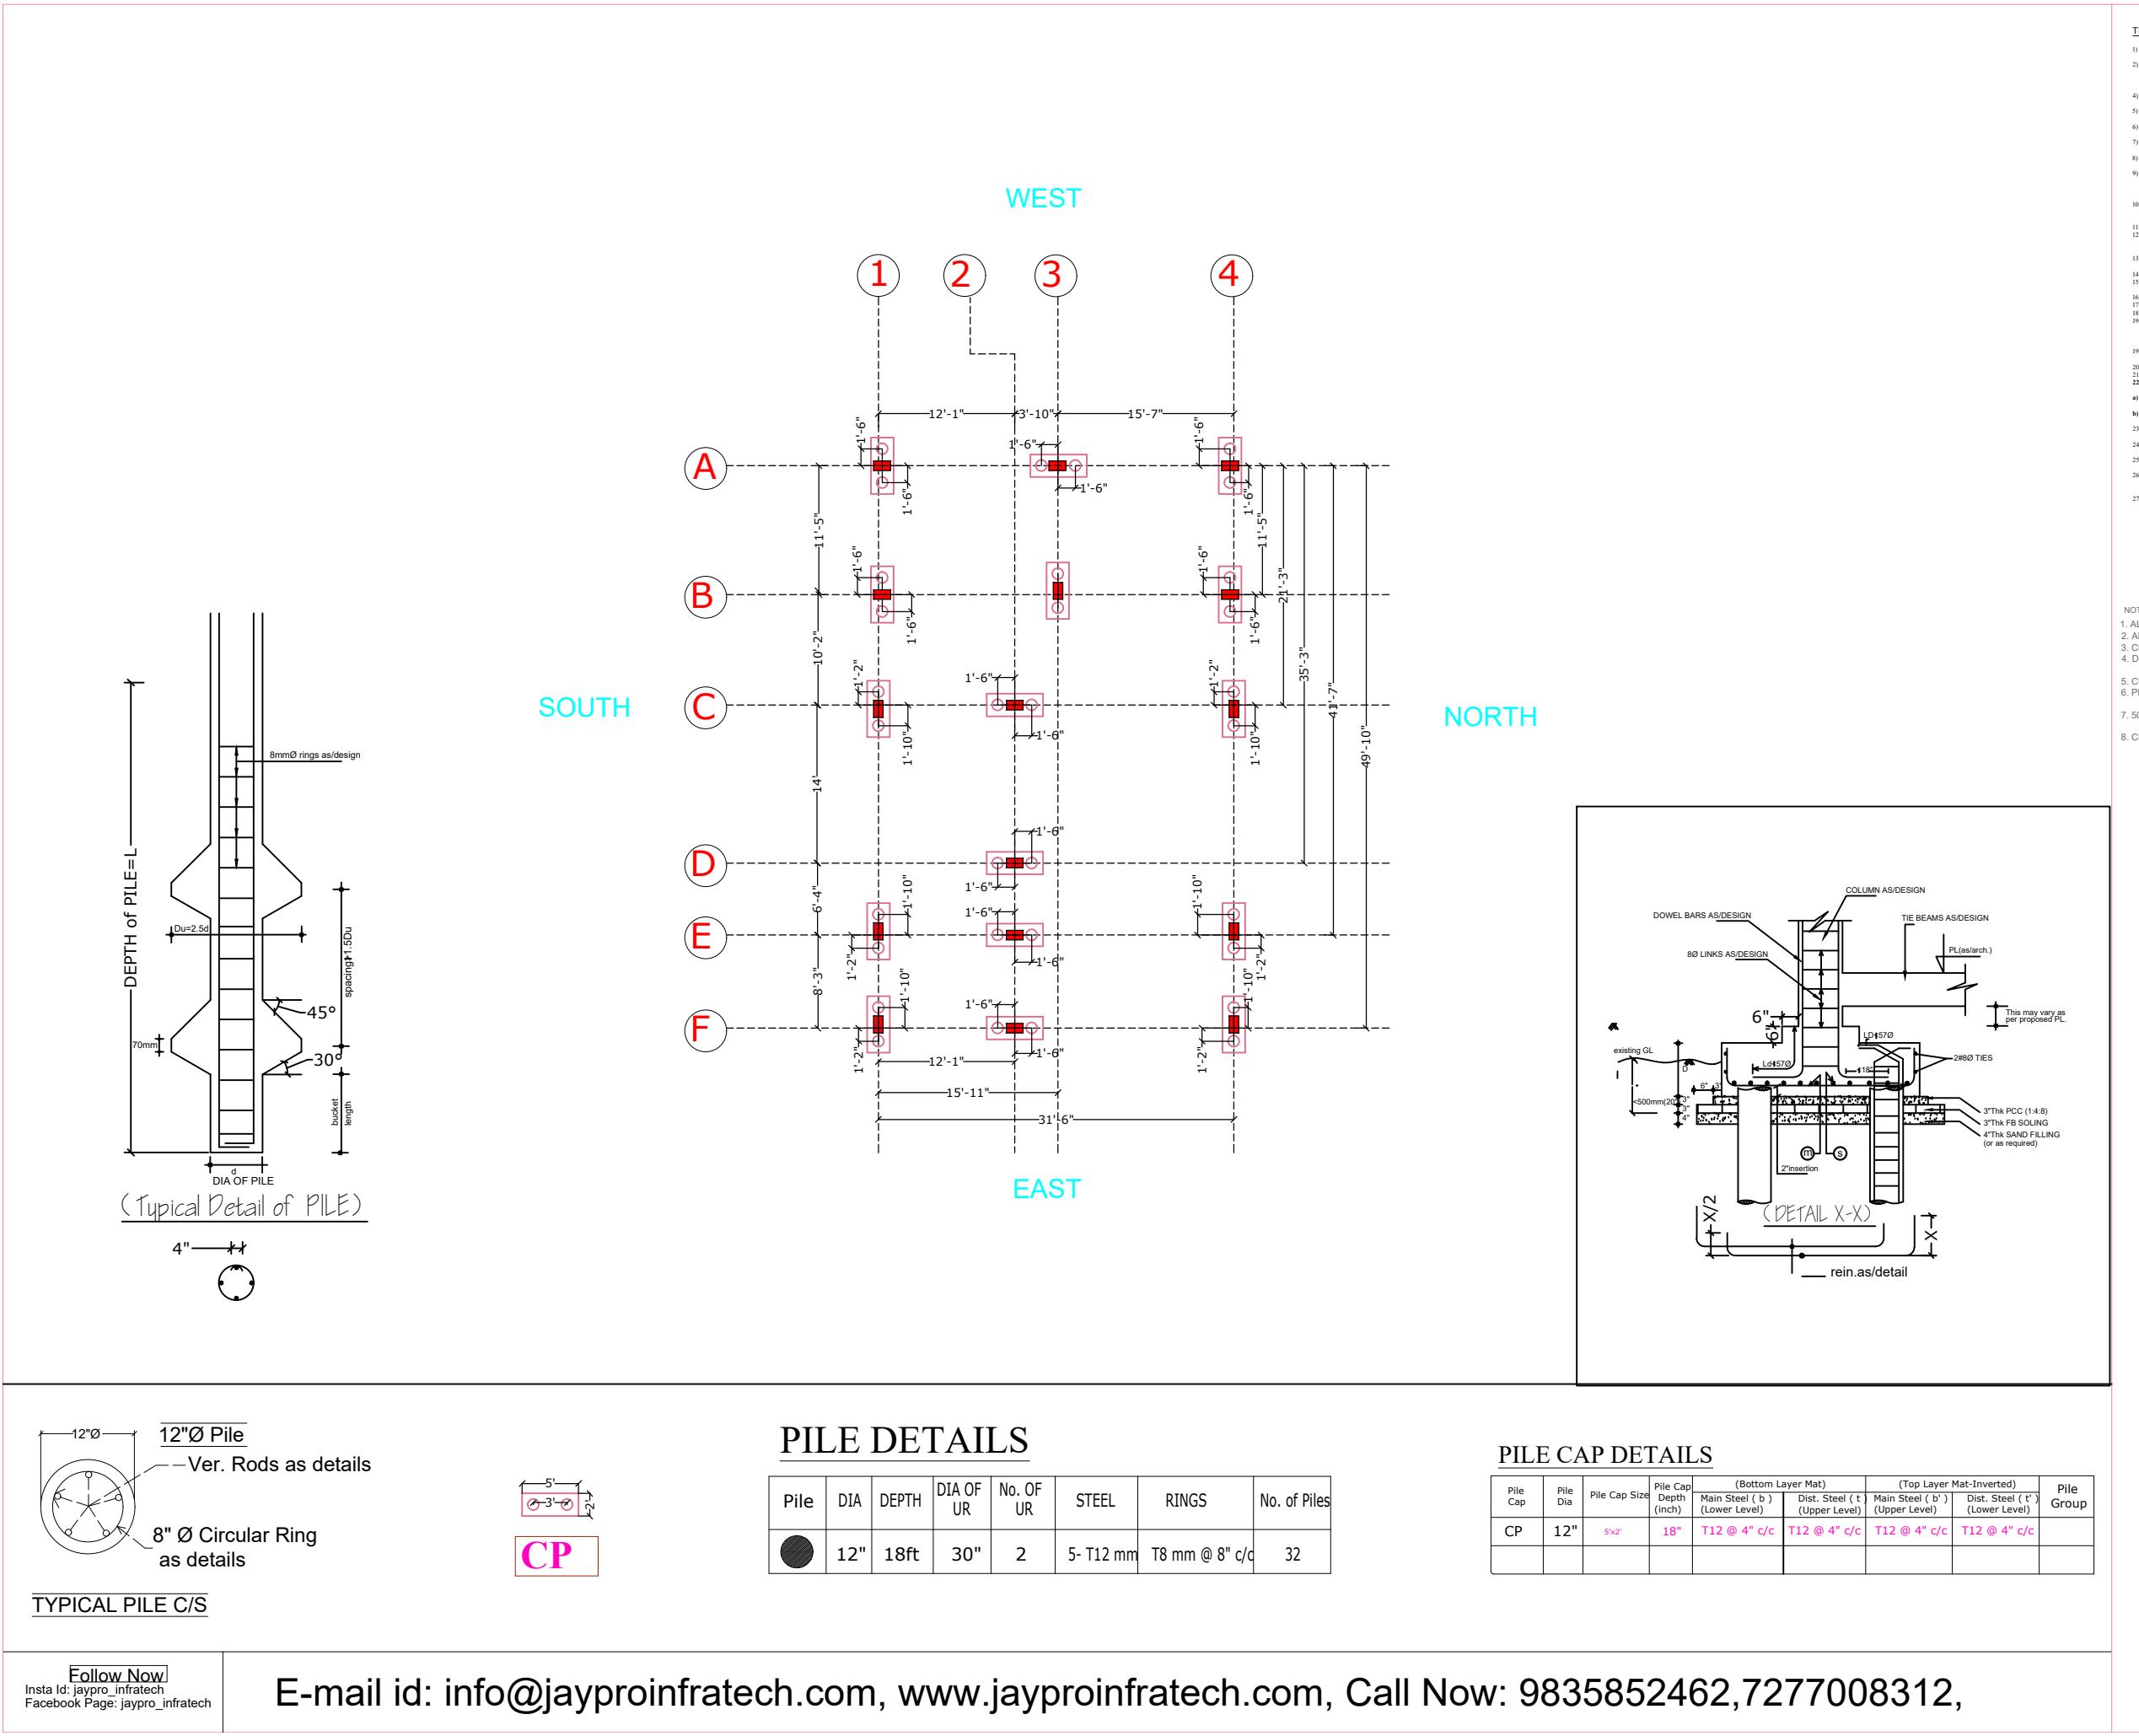





WEST

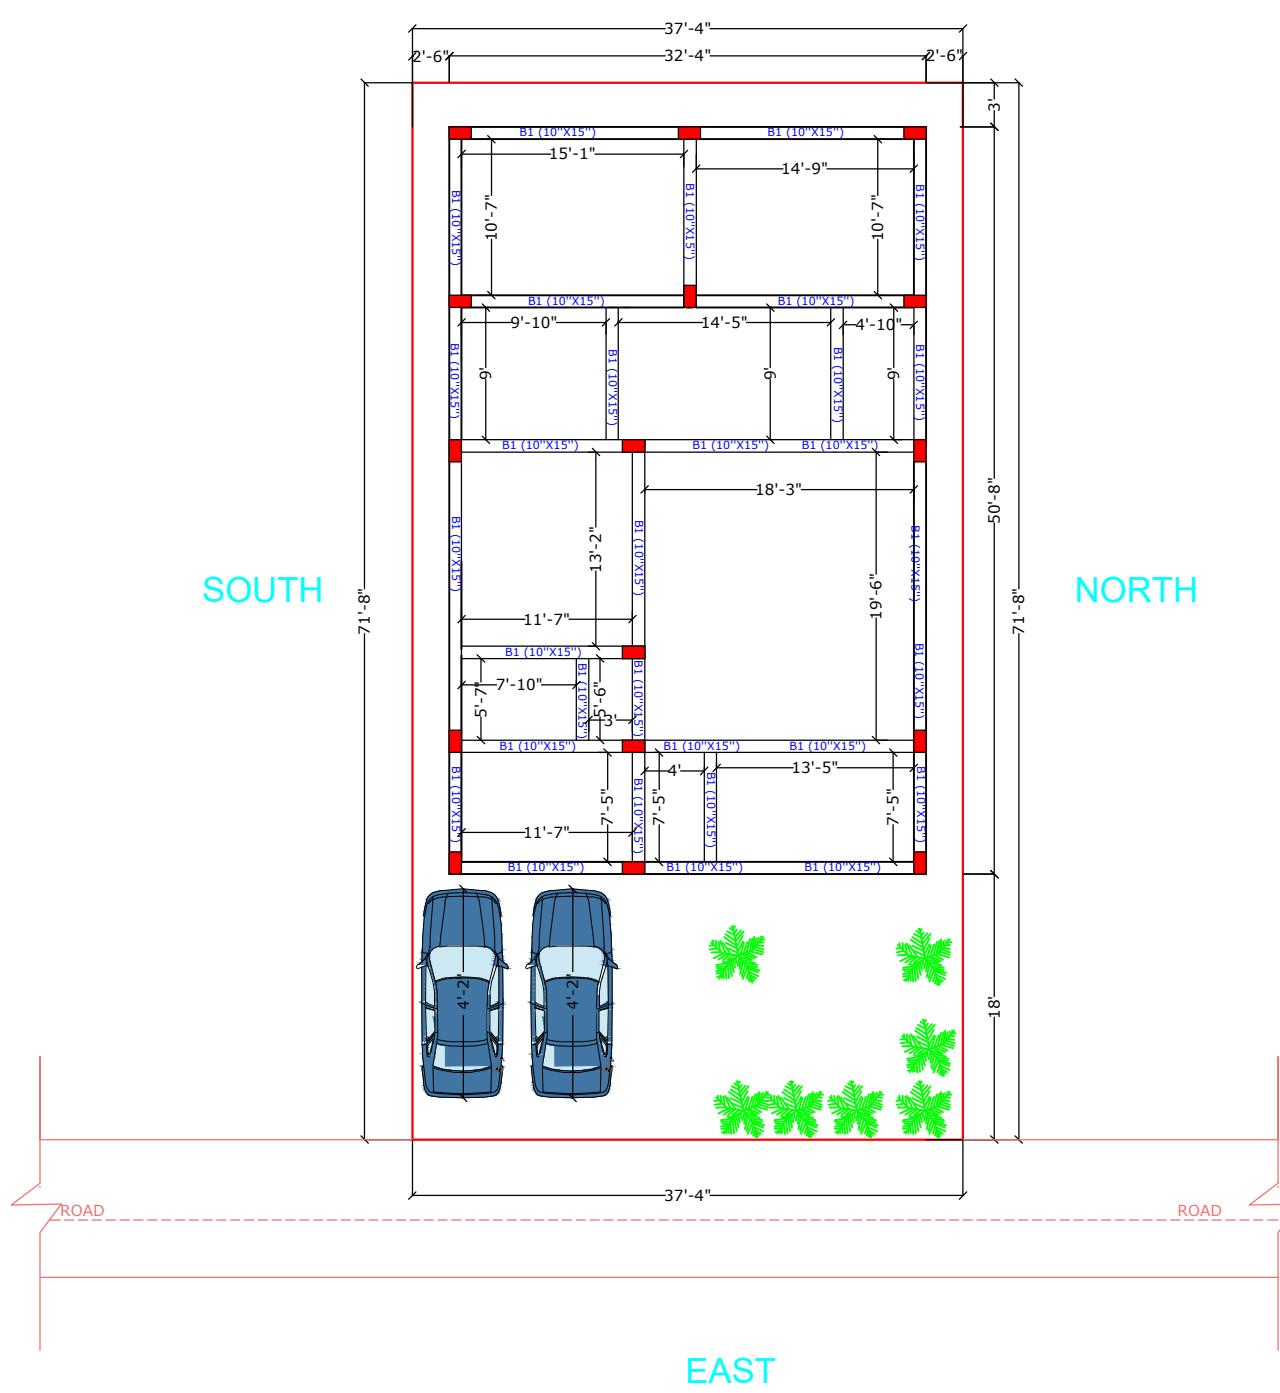

BEAM REINFORCEMENT INDEX

BEAM MKD	SIZE		REINFORCEMENT				STIRRUPS	
			TOP REINF.		BOT. REINF.			
	B	D	TOP.M (t1)	TOP.EXT (t2)	BOT.M (b1)	BOT.EXT (b2)	S1	S2
B1	10"	15"	2-T16	2-T12	2-T16	2-T12	T8@5" c/c	T8@5" c/c

EAST

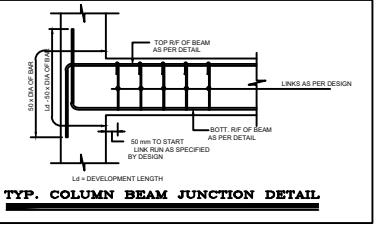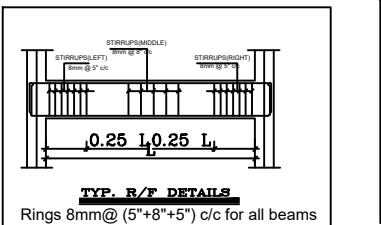

TECHNICAL NOTES & INSTRUCTIONS:

1) NOTES AND INSTRUCTIONS INDICATED BELOW SHALL BE FOLLOWED WITH DUE RESPONSIBILITY BY ENGINEER IN CHARGE DURING EXECUTION OF THE PROJECT.

2) THE ENGINEER IN-CHARGE SHALL STUDY THE PLAN THE ARCHITECTURAL, STRUCTURAL, DRAUGHTING AND REINFORCEMENT DETAILS AND REPORT TO CONSULTANT FOR AMBIGUITY IF ANY NOTICED BY HIM SHALL BE REPORTED TO CONSULTANT, FOR NECESSARY ACTION.

3) ONLY APPROVED ENGINEER'S CERTIFICATE SHALL BE PROVIDED ON THE WORK SITE FOR CONSTRUCTION OF R.C.C. FRAMED BUILDINGS.

4) QUANTITY OF CONCRETE AND PROPORTION OF MATERIALS TO BE USED IN CONCRETING ETC. CEMENT / SAND / CHIPS SHALL BE STRICTLY AS PER DESIGN MIX.

5) THE CRUSHING STRENGTH OF CUBES PREPARED WITH CEMENT / MIX AT WORK SITE SHALL BE PROVIDED AS PER DESIGN.

6) THE ENGINEER IN-CHARGE SHALL PROVIDE CONCRETE MIXTURE FOR CEMENT / SAND / CHIPS.

7) COVER BLOCK WITH PROPER SIZE & SPECIFIED STRENGTH SHALL BE PROVIDED IN SLAB / BEAM / COLUMN AS PER DESIGN.

8) COVER BLOCK SHALL BE PROVIDED TIED WITH THE REINFORCEMENT FOR EXHIBITION.

9) IN CASE OF PILE FOUNDATION IT IS ESSENTIAL TO HAVE ACTUAL PILE LOAD TEST REPORT ALONG WITH PILE CAPACITY BASED ON SOIL PARAMETERS. SO IT IS INSTRUCTED TO GET THE ACTUAL PILE CAPACITY REPORT BEFORE EXECUTION AND REPORT TO CONSULTANT FOR REVIEW AND FINAL CONCLUSION.

10) IN CASE OF PILE FOUNDATION HAVING HIGH WATER TABLE USE BENTONITE SOLUTION, CASING AND PILE CAP AS PER DESIGN.

11) ALL CONCRETE SHALL BE MACHINE MIXED AND PROPERLY COMPACTED BY VIBRATOR.

12) ALL CONCRETE SHALL BE PLACED IN CONCRETE PUMPS AND PLACED IN FORMS INCLUDING LINKS FOR FOUNDATION = 50, PILE CAP = 40, COLUMN = 40, BEAM = 30 AND SLAB = 25mm THICKNESS.

13) PROPER CURE OF R.C.C. SLAB / COLUMN / FOUNDATION / B/W PLASTER ETC. SHALL BE PROVIDED.

14) PROPER ARRANGEMENT FOR STACKING OF BRICKS SHALL BE ENSURED BY FIELD ENGR.

15) BEFORE PLACING OF REINFORCEMENT POLYTHENE SHEET SHALL BE SPREAD OVER THE REINFORCEMENT.

16) BEFORE CASTING REINFORCEMENT PLACED SHALL BE DULY MEASURED BY ENGR INCHAGE.

17) L.D.F. (EFFECTIVE DEVELOP. LENGTH) CONSIDERING TENSION 40% BAR R.D.

18) L.D.F. (EFFECTIVE DEVELOP. LENGTH) CONSIDERING COMPRESSION 20% BAR R.D.

19a) LAP SPLICING - NOT MORE THAN 50% OF AREA OF STEEL (LONG) IN COLUMN SHALL BE SPLICED AT ANY ONE SECTION. LAP LENGTH OF SPlicing OF RT. SHALL BE STATED.

19b) IN CASE OF SPlicing OF LONGER LENGTH OF SPlicing, IT SHALL BE PROVIDED IN SEVERAL SPlices AT SPACING EQUAL TO 1.25 TIMES OF SPAN.

20) ONLY WRITTEN DIMENSIONS ARE TO BE FOLLOWED.

21) THE FORM WORK FOR SPAN & BEAMS & SLAB SHALL BE SO ASSEMBLED AS TO PROVIDE CAMBER AS PER DESIGN.

22) a) CAMBER FOR NORMAL BEAMS SHALL BE 1 IN 250 OF THE SPAN OR 5MM PER METER OF SPAN AT THE CENTRAL POINT.

b) FOR TIE BEAMS, THE CAMBER FOR SLAB CAMBER AT THE FREE END SHALL BE SPAN / 50 OF THE PROJECTED LENGTH.

23) BEFORE R.C.C. CASTING OF BEAMS-SLAB FORM WORK SHALL BE CHECKED PROPERLY TO AVOID ANY DEFECTS.

24) REMOVAL OF FORM WORK SHALL BE AS PER STRIPPING TIME PRESCRIBED VIDE CL. 11.1 OF I.S. 456-2000 AND AS PER DESIGN.

25) IN FRAME STRUCTURE ALL EXTERNAL STAIR WALL SHALL BE 10"THICK AND INTERNAL WALL SHALL BE 5" THICK, EXCEPT MENTIONED.

NOTES:

a) NO CLOTHESLINE OR HANGING SHALL BE MADE FOR PLANT PROTECTION OF BUILDING AT LEVEL DECIDED BY E.E. TO AVOID WATER LOGGING AROUND BUILDING THE DRAINAGE SHALL BE PROVIDED.

b) WATER PROOFING COMPOUND SHALL BE USED IN CASTING OF SUNKEN SLAB ATTIC FLOOR SLAB TO PREVENT SEEPAGE.

ALL LIQUID AGGREGATE GRADE M20 HAVING MINIMUM CEMENT CONTENT 300 kg/m³, MAX. W/C = 0.5 FOR COARSE AGGREGATE 20 mm SIZE CASTING SHOULD BE DONE AS PER MIX DESIGN.

O T INDICATES HYD BARS OF GRADE Fe-500

THIS DRAWING SHALL BE READ WITH THE APPROVED ARCHITECTURAL DRAWINGS.

NOTES:-

- ALL DIMENSIONS ARE IN FEET AND INCHES
- ALL CONCRETE MIX M20 UNLESS OTHERWISE SPECIFIED.
- ALL TOR STRENGTH 500 N/mm
- ALL CONCRETE SHALL BE MACHINE MIXED AND PROPERLY COMPACTED.
- CLEAR COVER TO MAIN STEEL - 40 MM IN PILES, 20mm IN SLAB, 25mm IN BEAM, 40mm IN COLUMN.
- ALL DIMENSIONS ARE TO BE READ NOT TO BE MEASURED.
- ALL DIMENSIONS & DETAILS ARE TO BE VERIFIED WITH THE ARCHITECTURAL DRAWING AMBIGUITY IF ANY SHOULD BE BROUGHT TO THE NOTICE OF THE CONSULTING ENGINEERS.
- WHEREVER SHOWN BEAM BAR SHALL BE ANCHORED INTO COLUMN UP TO A LENGTH EQUAL TO 50 BAR DIAMETER MEASURED FROM COLUMN FACE
- BARS TO BE CUT & BENT NEAR OPENINGS/POCKETS.

THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF
PURPOSE AS STATED IN THE AGREEMENT AND IT SHALL NOT BE REPRODUCED,
COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED
FOR ANY OTHER PURPOSE.

ALL DIMENSIONS ARE IN MILLIMETER UNLESS OTHERWISE SPECIFIED.


CLIENT : - MD FARUQUE SIR

PROJECT : - GROUND FLOOR TIE BEAM

SCALE :	1:100	19.11.2025
Plan Number	01	
Design By	Ar. Soni Kumar	
Checked By	Er. Jayprakash Kumar	
Approved By	Jaypro Infratech Pvt. Ltd.	

JAYPRO INFRATECH PVT. LTD.

Office Address: 1st Floor, Pandooi Place, Boring Road, Patna- 80001

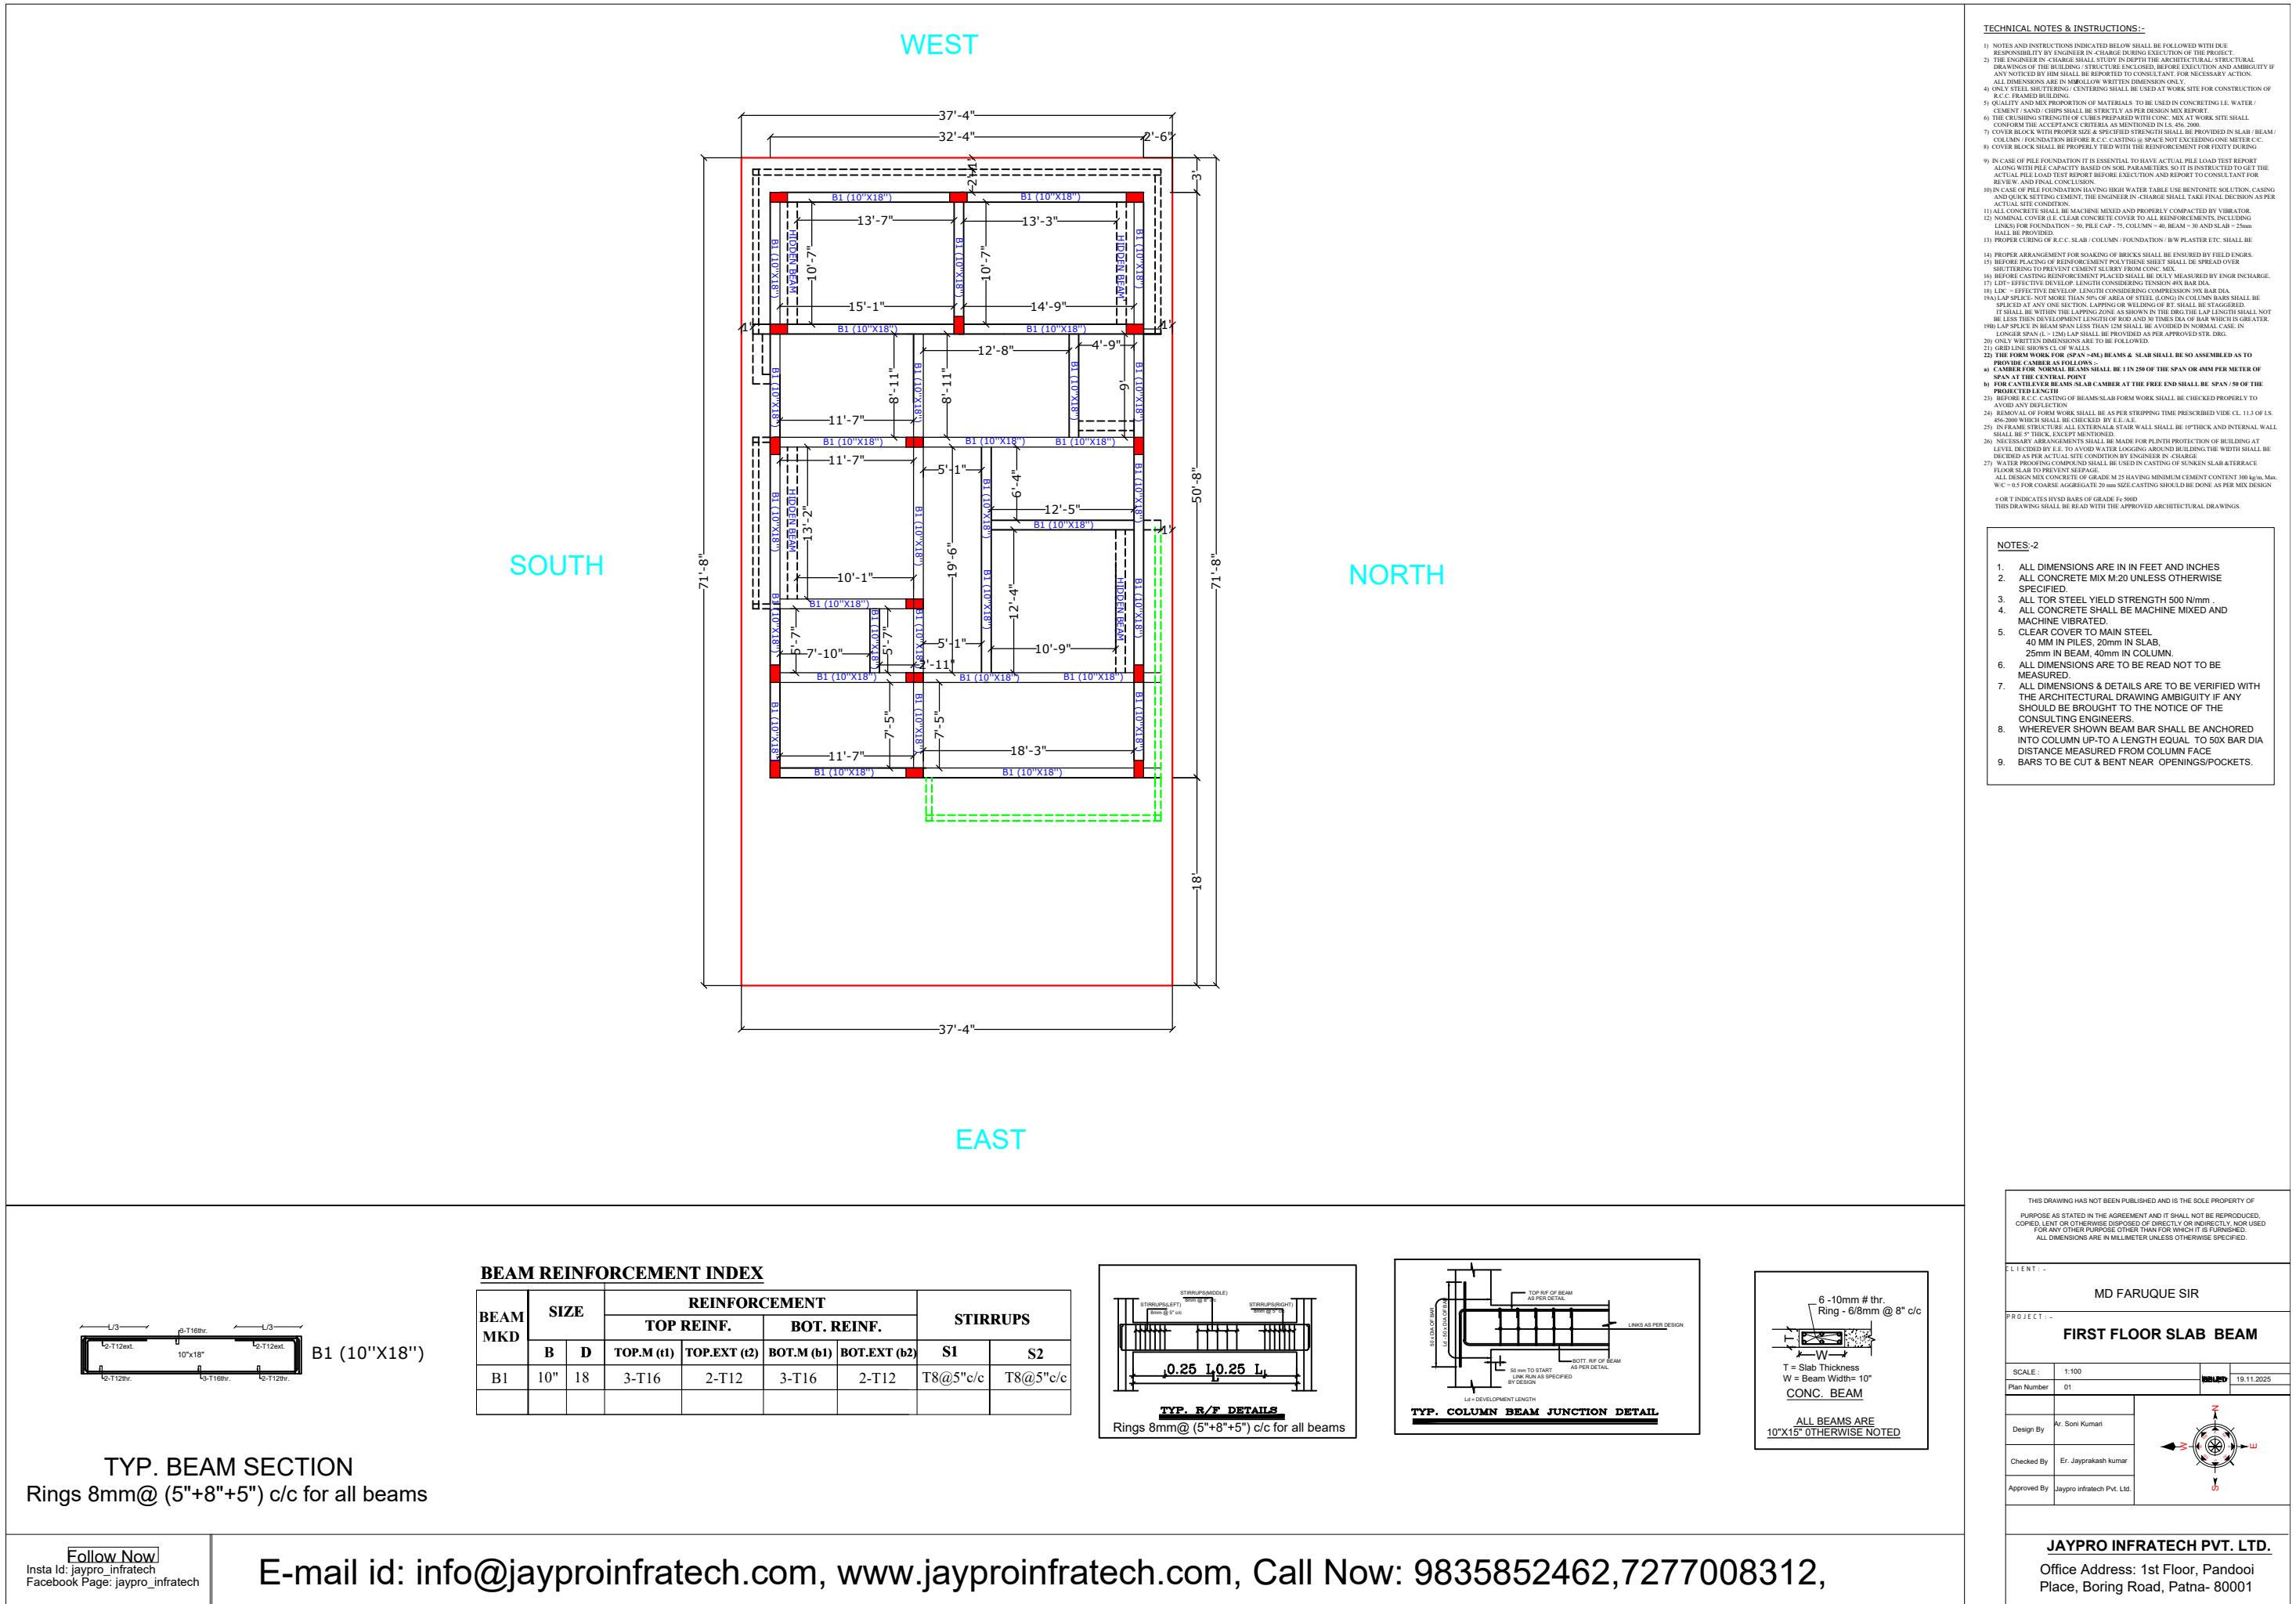


Our Services

Architecture Design
Structure Design
Interior Design
Estimating & Costing
Building Construction With Material

LEGEND

SYMBOL	DESCRIPTION	HEIGHT
Ceiling Fan	CEILING FAN	ON CEILING
Chandelier Light Point	CHANDELIER LIGHT POINT	ON CEILING
40Wx4" TUBE LIGHT FITTING	40Wx4" TUBE LIGHT FITTING	86"
BLUB	BLUB	86"
NIGHT BLUB	NIGHT BLUB	86"
C.F.L	C.F.L	ON CEILING
SPORT LIGHT	SPORT LIGHT	ON CEILING
CEILING LIGHT	CEILING LIGHT	ON CEILING
FLASH JUNCTION BOX	FLASH JUNCTION BOX	ON CEILING
SWITCH BOARD	SWITCH BOARD	46" HT
BED SWITCH	BED SWITCH	26" HT
TWO WAY SWITCH	TWO WAY SWITCH	ON SWITCH
5 AMPS SWITCH SOEKET	5 AMPS SWITCH SOEKET	16" HT
15 AMPS SWITCH SOEKET	15 AMPS SWITCH SOEKET	16" HT
25 AMPS SWITCH SOEKET (A.C)	25 AMPS SWITCH SOEKET (A.C)	16" HT
CALL BELL BUZZER	CALL BELL BUZZER	16" HT
CALL BELL PUSH	CALL BELL PUSH	46" HT
OUT LET FOR TELEPHONE	OUT LET FOR TELEPHONE	16" HT
OUT LET FOR TV	OUT LET FOR TV	16" HT
EXHAUST FAN (IN TOI & KIT)	EXHAUST FAN (IN TOI & KIT)	
TABLE LAMP	TABLE LAMP	
ROOT OF TV/TELEPHONE WIRING	ROOT OF TV/TELEPHONE WIRING	
ROOT OF POINT WIRING (25MM)	ROOT OF POINT WIRING (25MM)	
ROOT OF POINT WIRING (19MM)	ROOT OF POINT WIRING (19MM)	
ROOT OF CIRCUIT WIRING (19MM)	ROOT OF CIRCUIT WIRING (19MM)	
ROOT OF SUB MAIN WIRING (25MM)	ROOT OF SUB MAIN WIRING (25MM)	
WALL FAN	WALL FAN	
DISTRIBUTION BOARD	DISTRIBUTION BOARD	
METERING PANAL	METERING PANAL	



THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF PURPOSE AS STATED IN THE AGREEMENT AND IT SHALL NOT BE REPRODUCED, COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY OTHER PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED. ALL DIMENSIONS ARE IN MILLIMETER UNLESS OTHERWISE SPECIFIED.

CLIENT :- MD FARUQUE SIR

PROJECT :- Ground Floor Electric design

SCALE:-	1:100	ISSUED	27.11.25
Plan Number:-	11		
Design By	Ar. Soni Kumari		
Checked By	Er. Jayprakash Kumar		
Approved By	Jaypro Infratech Pvt.Ltd.		

Jaypro Infratech Pvt.Ltd.

Office Address: 1st Floor, Pandooi Place, Boring Road, Patna- 80001

Follow Now :-


You Tube :- jaypro_infratech
Facebook Page :- jaypro_infratech
Insta Id :- jaypro_infratech

E-Mail Id :- info@jayproinfratech.com, www.jayproinfratech.com, Call No:- 9835852462, 7277008312,

SOUTH

NORTH

EAST

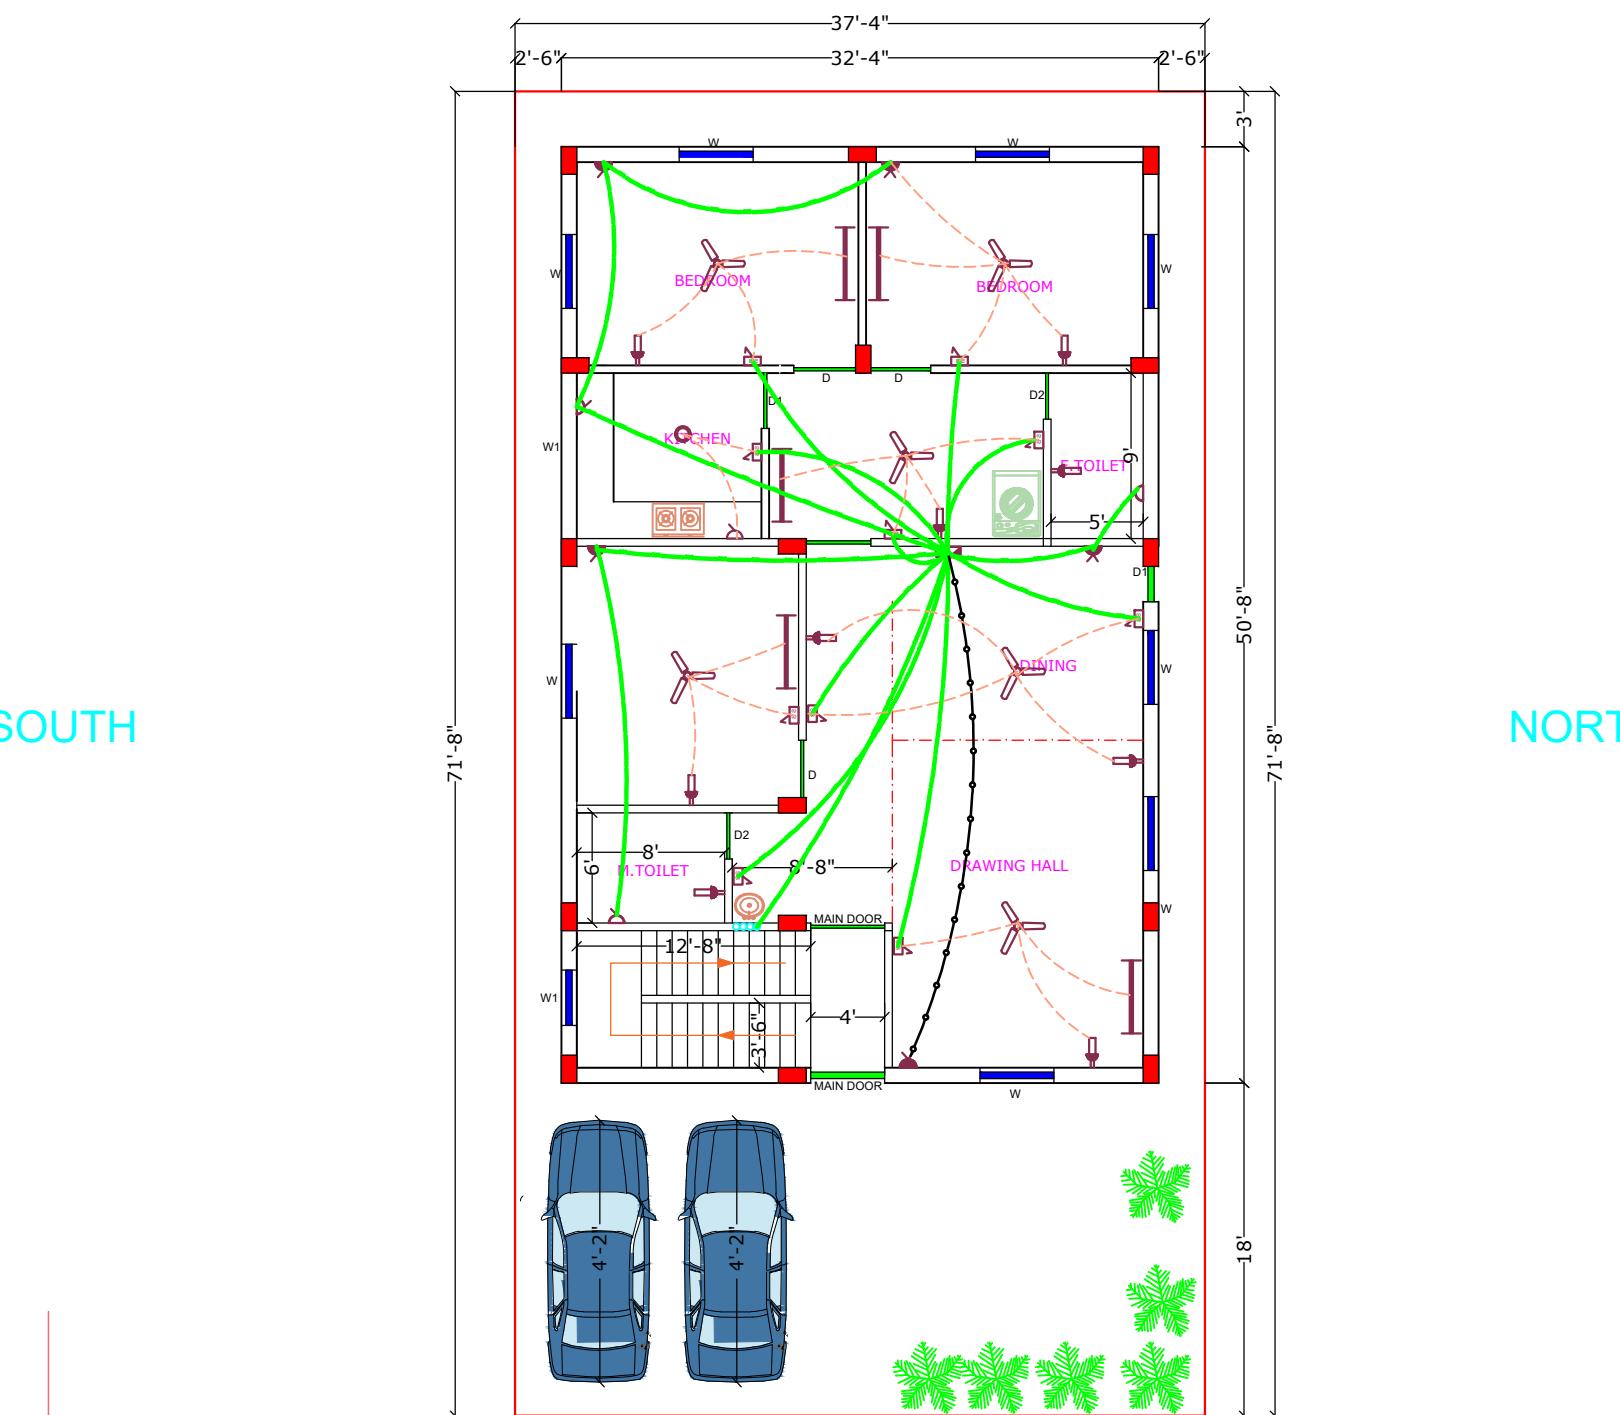

JAYPRO INFRATECH PVT.LTD.

Our Services

Architecture Design
Structure Design
Interior Design
Estimating & Costing
Building Construction With Material

LEGEND

SYMBOL	DESCRIPTION	HEIGHT
	CEILING FAN	ON CEILING
	CHANDELIER LIGHT POINT	ON CEILING
	40Wx4'0" TUBE LIGHT FITTING	86"
	BLUB	86"
	NIGHT BLUB	86"
	C.F.L	ON CEILING
	SPORT LIGHT	ON CEILING
	CEILING LIGHT	ON CEILING
	FLASH JUNCTION BOX	ON CEILING
	SWITCH BOARD	46" HT
	BED SWITCH	26" HT
	TWO WAY SWITCH	ON SWITCH
	5 AMPS SWITCH SOEKET	16" HT
	15 AMPS SWITCH SOEKET	16" HT
	25 AMPS SWITCH SOEKET (A.C.)	16" HT
	CALL BELL BUZZER	16" HT
	CALL BELL PUSH	46" HT
	OUT LET FOR TELEPHONE	16" HT
	OUT LET FOR TV	16" HT
	EXHAUST FAN (IN TOI & KIT)	
	TABLE LAMP	
	ROOT OF TV TELEPHONE WIRING	
	ROOT OF POINT WIRING (25MM)	
	ROOT OF POINT WIRING (19MM)	
	ROOT OF CIRCUIT WIRING (19MM)	
	ROOT OF SUB MAIN WIRING (25MM)	
	WALL FAN	
	DISTRIBUTION BOARD	
	METERING PANAL	

THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF
PURPOSE AS STATED IN THE AGREEMENT AND IT SHALL NOT BE REPRODUCED,
COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED
FOR ANY OTHER PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.
ALL DIMENSIONS ARE IN MILLIMETER UNLESS OTHERWISE SPECIFIED.

CLIENT :- MD FARUQUE SIR

PROJECT :- First Floor Electric design

CALE:-	1:100	ISSUED	27.11.25
an Number:-	11		
esign By	Ar. Soni Kumari		
checked By	Er. Jayprakash Kumar		
proved By	Jaypro Infratech Pvt.Ltd.		


Jaypro Infratech Pvt.Ltd.

Office Address: 1st Floor, Pandooi Place, Boring Road, Patna- 80001

Follow Now :-

You Tube :- jaypro_infratech
Facebook Page :- jaypro_infratech
Insta Id :- jaypro_infratech

E-Mail Id :- info@jayproinfratech.com, www.jayproinfratech.com, Call No:- 9835852462, 7277008312,

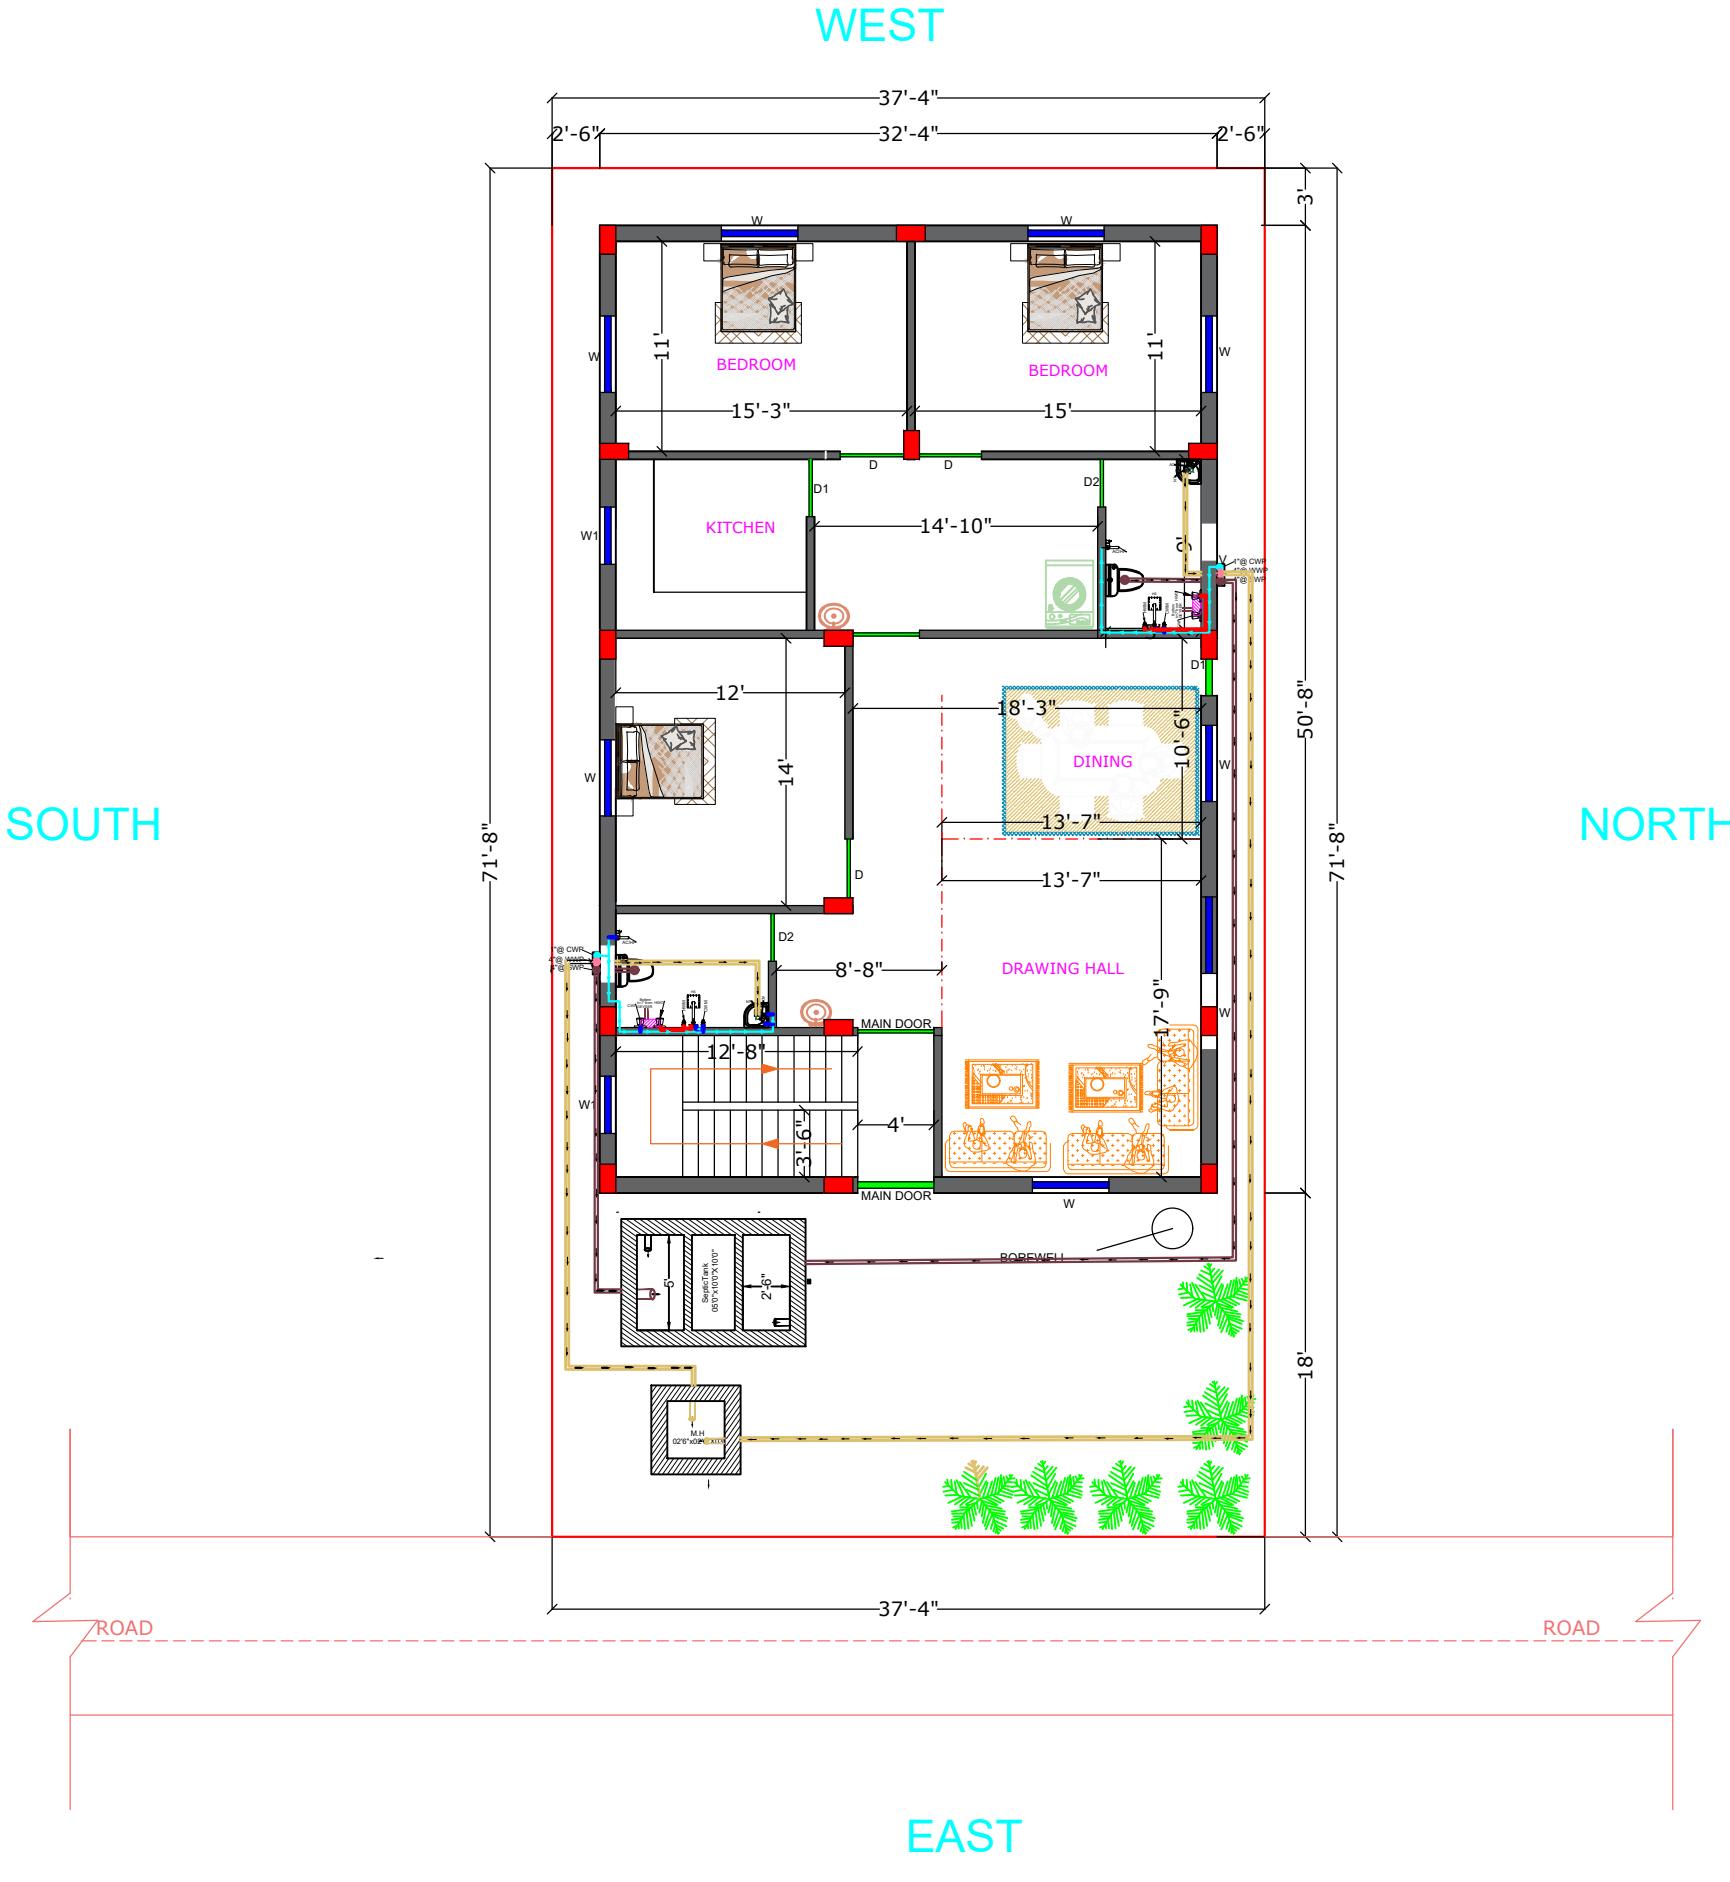

JAYPRO INFRATECH PVT.LTD.

Our Services

Architecture Design
Structure Design
Interior Design
Estimating & Costing
Building Construction With Material

LEGEND:-

NT- ANTI
AC- ANGLE COCK at 3' h
AC/HF- ANGLE COCK/HEALTH FAUCET GUN at 2' h
CWI- COLD WATER IN at 7' h
HWO- HOT WATER OUT at 7' h
HWM- HOT WATER MIXER at 4' h
CWM- COLD WATER MIXER at 4' h
TAP- TAP at 3' h
HS- HEAD SHOWER at 7' h
BT- BOTTLE TRAP
MP- METROPOLE FLUSH at 3' h
AC-HW- ANGLE COCK FOR HOT WATER at 2' h
AC-CW- ANGLE COCK FOR COLD WATER at 2' h
BT- BOTTLE TRAP
RWP- RAIN WATER PIPE
—
1/2" @ COLD WATER PIPE - SH-40 UPVC
—
3/4" @ HOT WATER PIPE - CPVC SDR - 11 PIPE
—
1" @ COLD WATER PIPE - UPVC PIPE
—
2 1/2" @ WASTE WATER PIPE - 6KG/CM2 PVC FOR WASH BASIN
—
4" @ WASTE WATER LINE - 6KG/CM2 PVC PIPE
—
6" @ SOIL WATER LINE - 6KG/CM2 PVC PIPE
—
9 RISER - 2" @ COLD WATER DOWNTAKE - SH - 40 PVC PIPE
—
9 CWP - 2" @ COLD WATER PIPE - SH-40 PVC
—
9 WWP - 4" @ WASTE WATER PIPE - PVC 6 KG/CM2
—
9 SWP - 6" @ SOIL WATER PIPE - PVC 6 KG/CM2

E

THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF
PURPOSE AS STATED IN THE AGREEMENT AND IT SHALL NOT BE REPRODUCED,
COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED
FOR ANY OTHER PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.
ALL DIMENSIONS ARE IN MILLIMETER UNLESS OTHERWISE SPECIFIED.

CLIENT :- MD FARUQUE SIR

PROJECT :- Ground Floor plumbing design

SCALE:-	1:100		
Plan Number:-	11	ISSUED	27.11.25
Design By	Ar. Soni Kumari	 N S E W	
Checked By	Er. Jayprakash Kumar		
Approved By	Jaypro Infratech Pvt.Ltd.		

Jaypro Infratech Pvt.Ltd.



Office Address: 1st Floor, Pandooi Place, Boring Road, Patna- 80001

Follow Now :-
You Tube :- jaypro_infratech
Facebook Page :- jaypro_infratech
Insta Id :- jaypro_infratech

E-Mail Id :- info@jayproinfratech.com, www.jayproinfratech.com, Call No:- 9835852462, 7277008312,

Our Services

Architecture Design
Structure Design
Interior Design
Estimating & Costing
Building Construction With Material

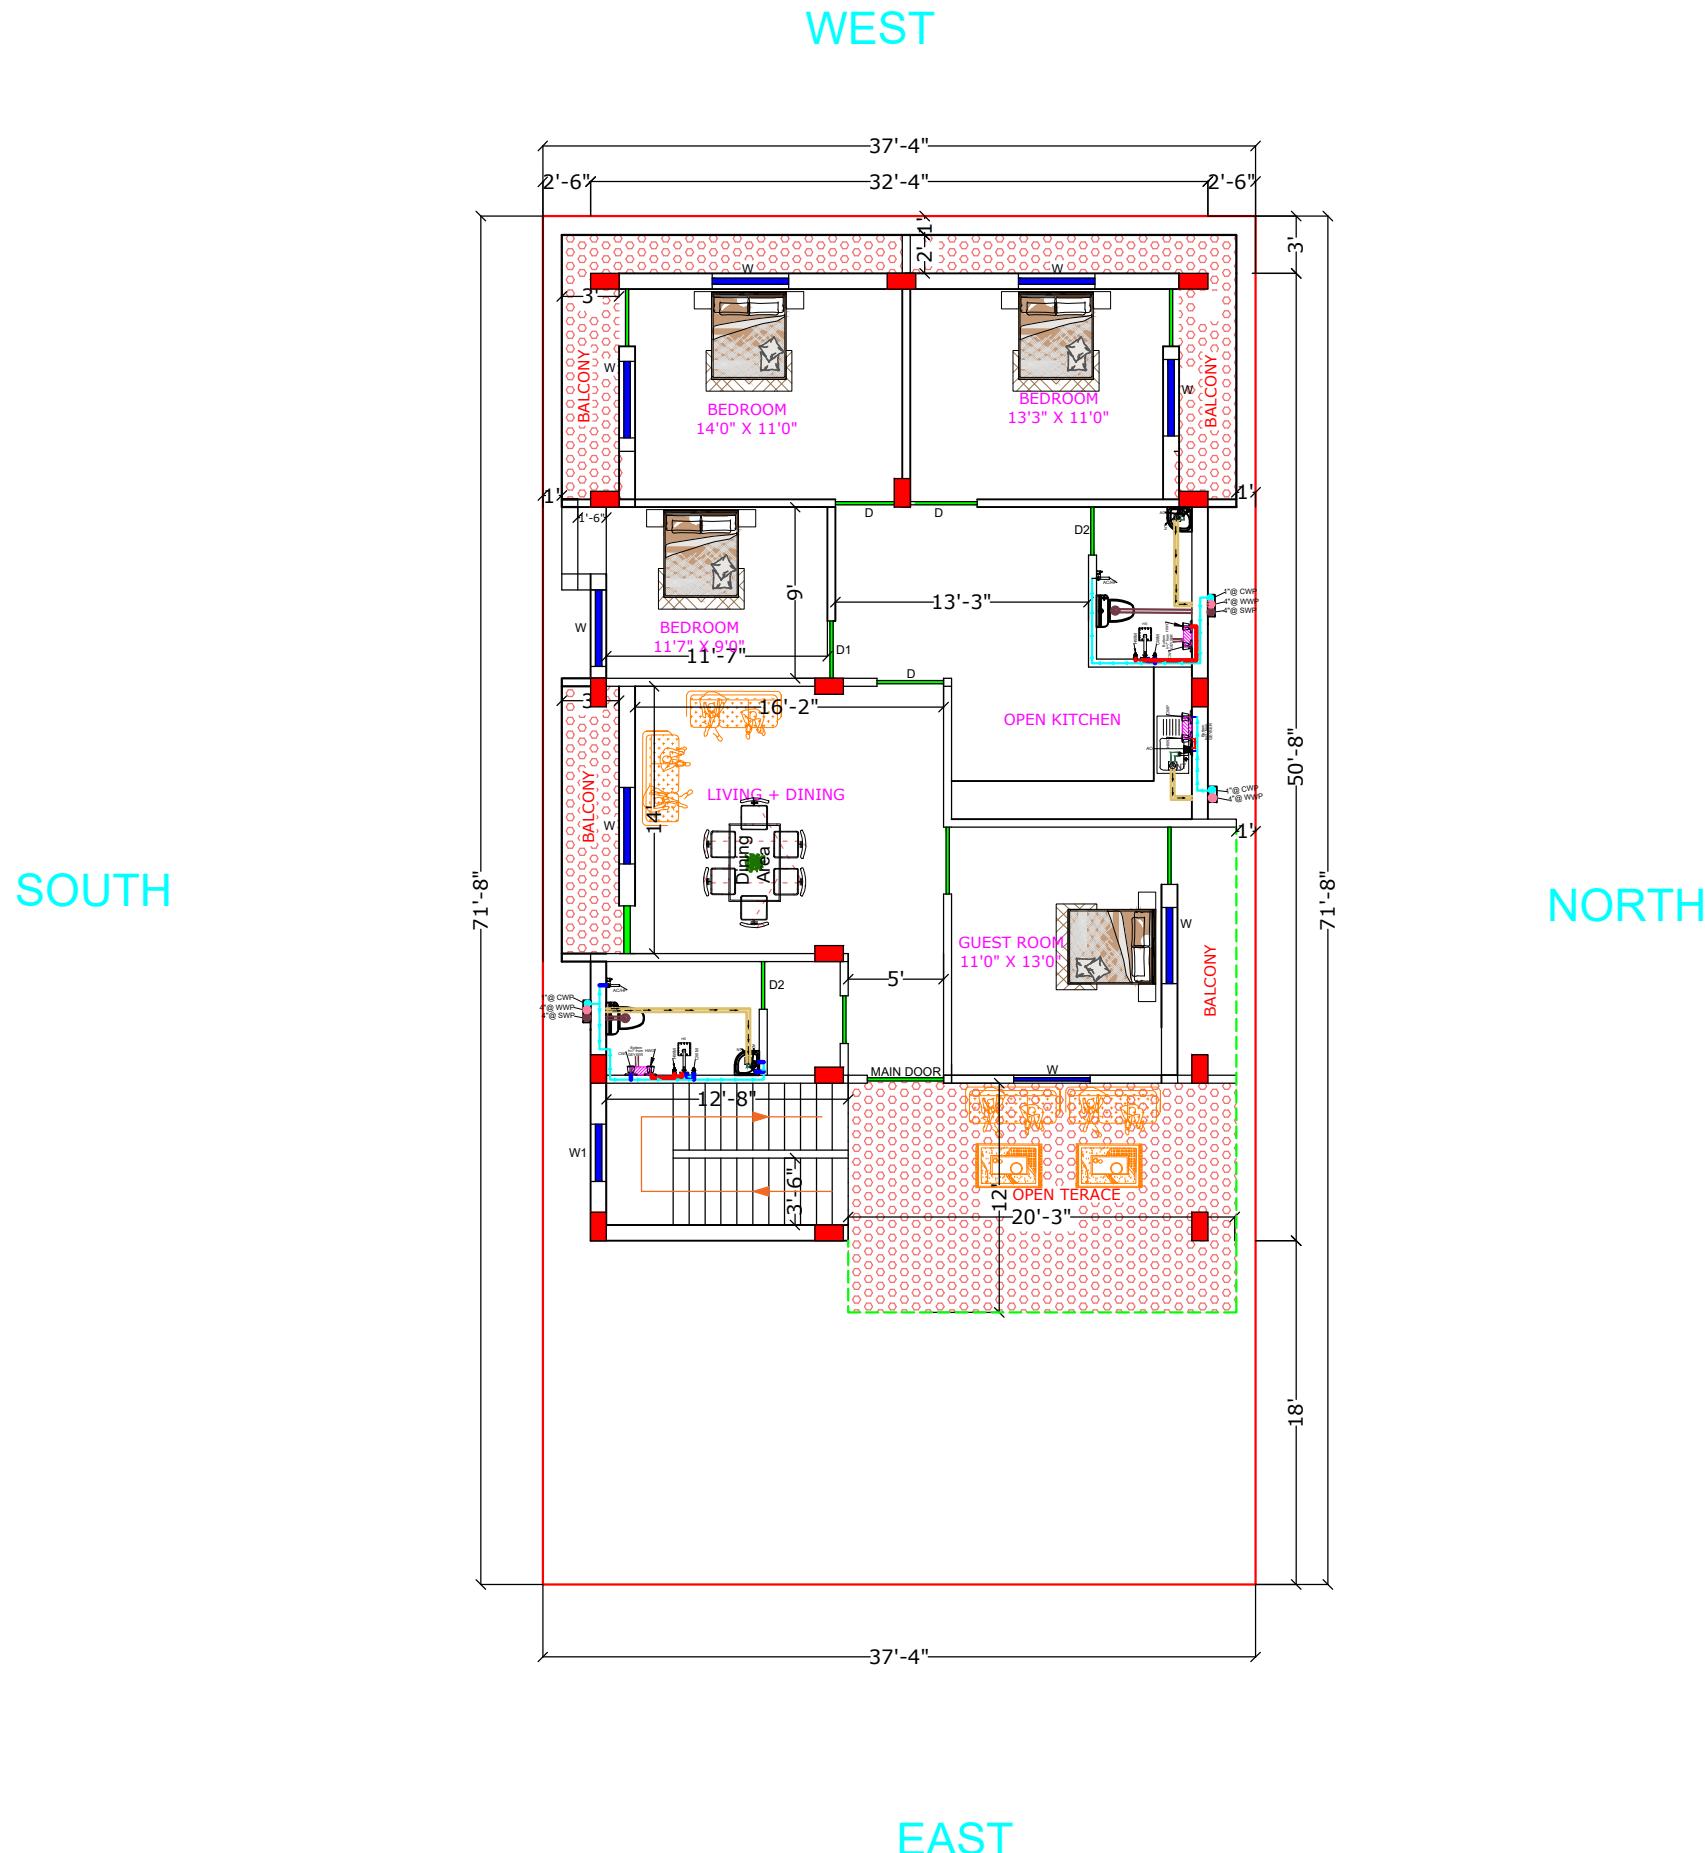

THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF PURPOSE AS STATED IN THE AGREEMENT AND IT SHALL NOT BE REPRODUCED, COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY OTHER PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED. ALL DIMENSIONS ARE IN MILLIMETER UNLESS OTHERWISE SPECIFIED.

CLIENT :- MD FARUQUE SIR

PROJECT :- First Floor plumbing design

SCALE:-	1:100	ISSUED	27.11.25
Plan Number:-	11		
Design By	Ar. Soni Kumari		
Checked By	Er. Jayprakash Kumar		
Approved By	Jaypro Infratech Pvt.Ltd.		

Jaypro Infratech Pvt.Ltd.

Office Address: 1st Floor, Pandooi Place, Boring Road, Patna- 80001

Follow Now :-

You Tube :- jaypro_infratech
Facebook Page :- jaypro_infratech
Insta Id :- jaypro_infratech

E-Mail Id :- info@jayproinfratech.com, www.jayproinfratech.com, Call No:- 9835852462, 7277008312,